


# Pressure test report



<b>Sensor:</b>		<b>Subject:</b>	
Model:	autosen AP019	Make:	Seaye
SN#:	KAB 1910	Model:	SM7
Calibration Date:	18-9-2020		
Test number:	15		

Parameter	Value	Units
Start time	17:06:52	N.A.
Total Recording Duration	95	Minutes
Number of samples recorded	5718	Samples
Total time under pressure	80	Minutes
Max pressure	32,14	Bar
Average pressure	30,29	Bar
Pressure fall	10,71	Bar

Pressure graph

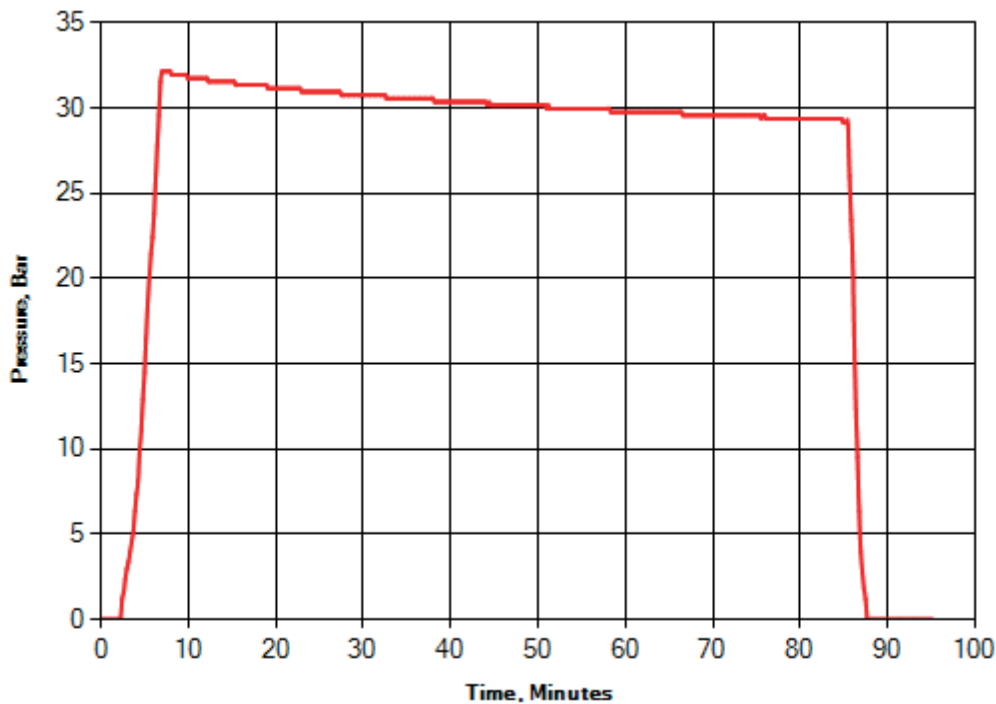

Test completed by:	Wouter Wellen
Signature:	
Date:	28-9-2020